


UKERC

FITS-LCD
Fabric-Integrated Thermal Storage in Low Carbon Dwellings



University of
Strathclyde
Engineering

5 problems and 5 solutions in decarbonising domestic heat... and what it means for networks


LCNI 2018 Conference – Views from Academia

Dr Graeme Hawker


Institute for Energy and Environment, Department of Electronic and
Electrical Engineering, University of Strathclyde

Local Network Modelling


Rural

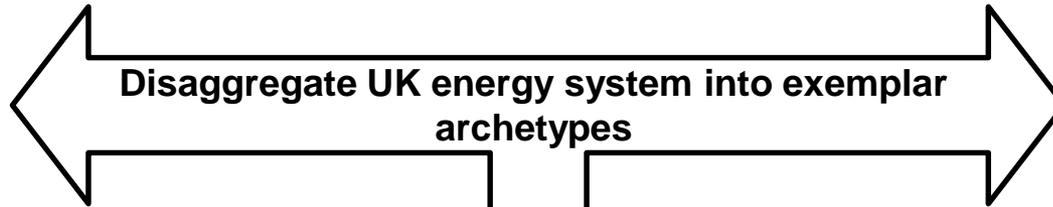




Urban

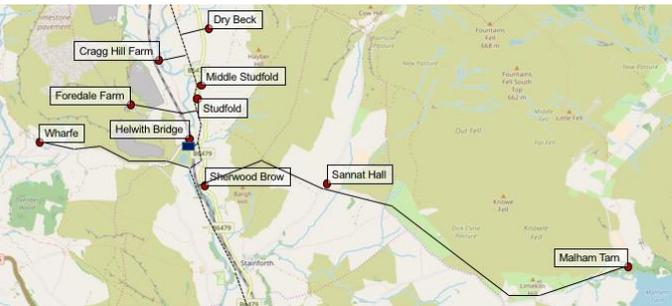

Suburban

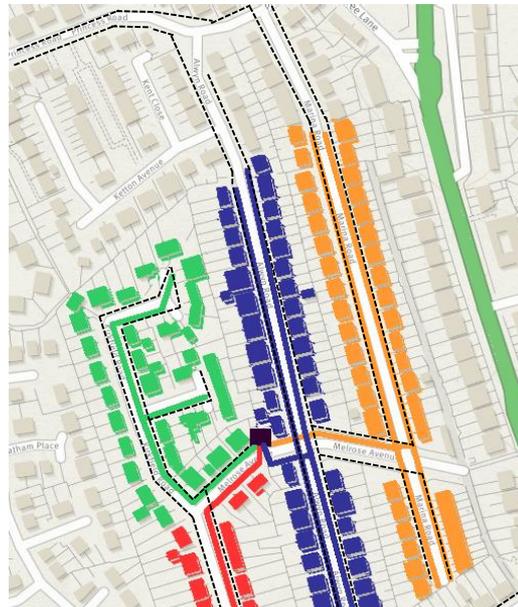


Demand and technology modelling

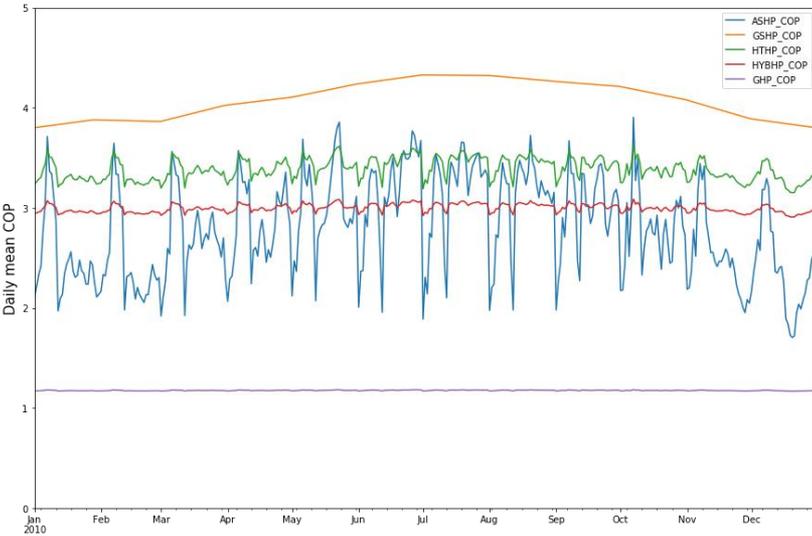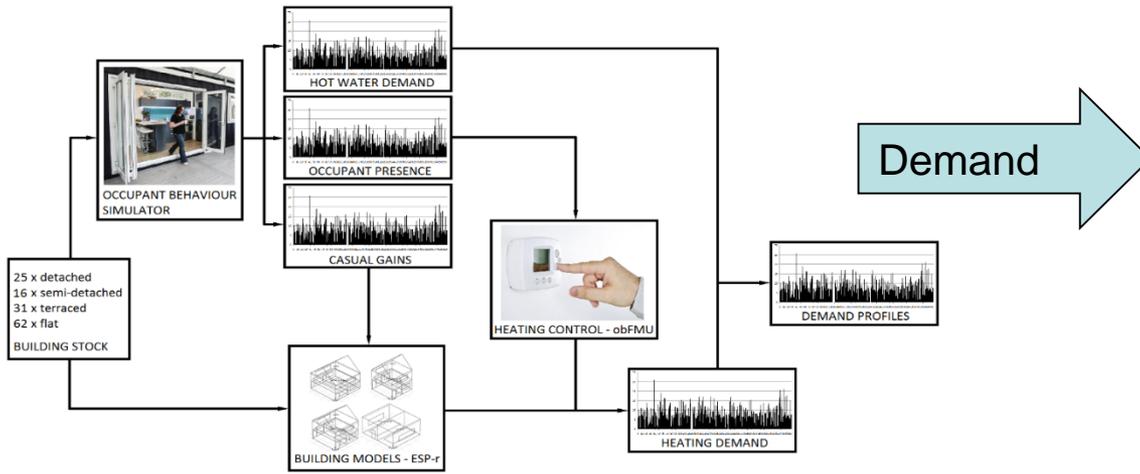

Problem 1: Peak heat demand pick-up

On 1st March 2018 at 6pm:


- hourly local gas demand: 214GW
- electrical supply: 53GW

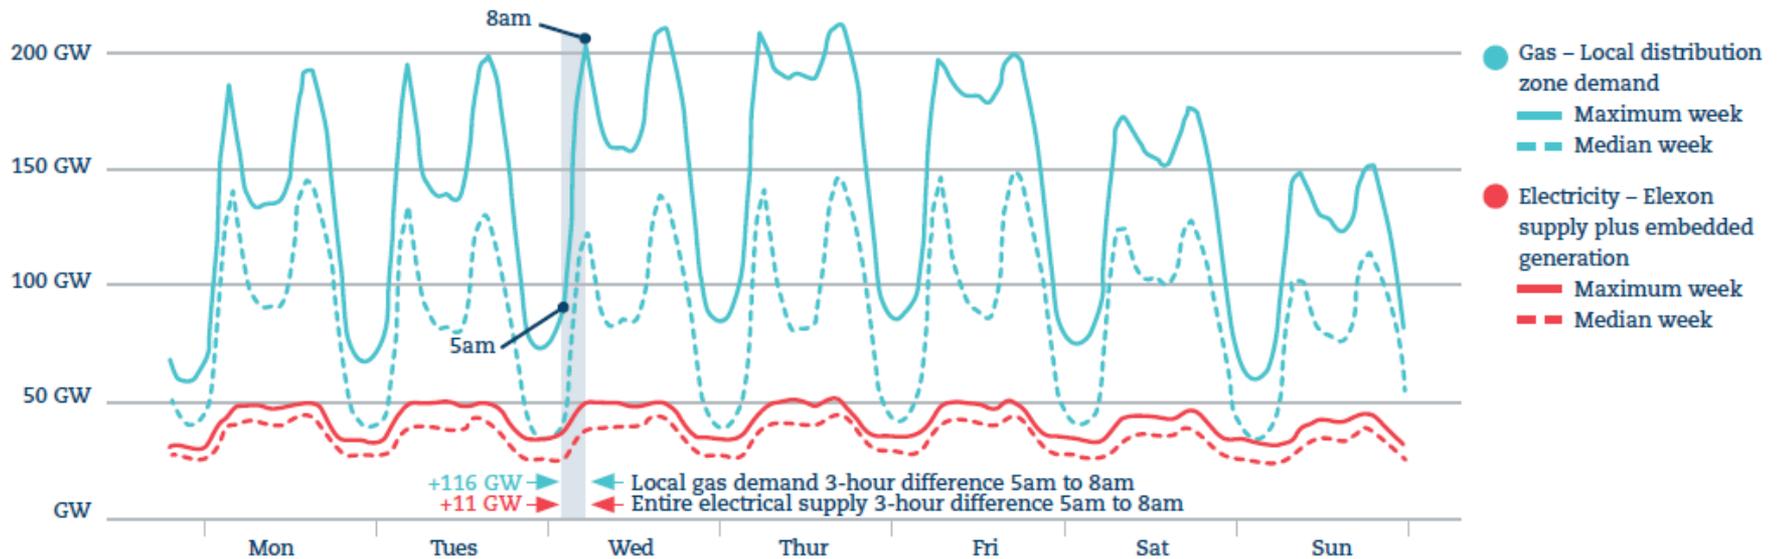

Grant Wilson, University of Birmingham

<http://www.ukerc.ac.uk/publications/local-gas-demand-vs-electricity-supply.html>

Problem 2: Heat load does not follow existing diversity patterns

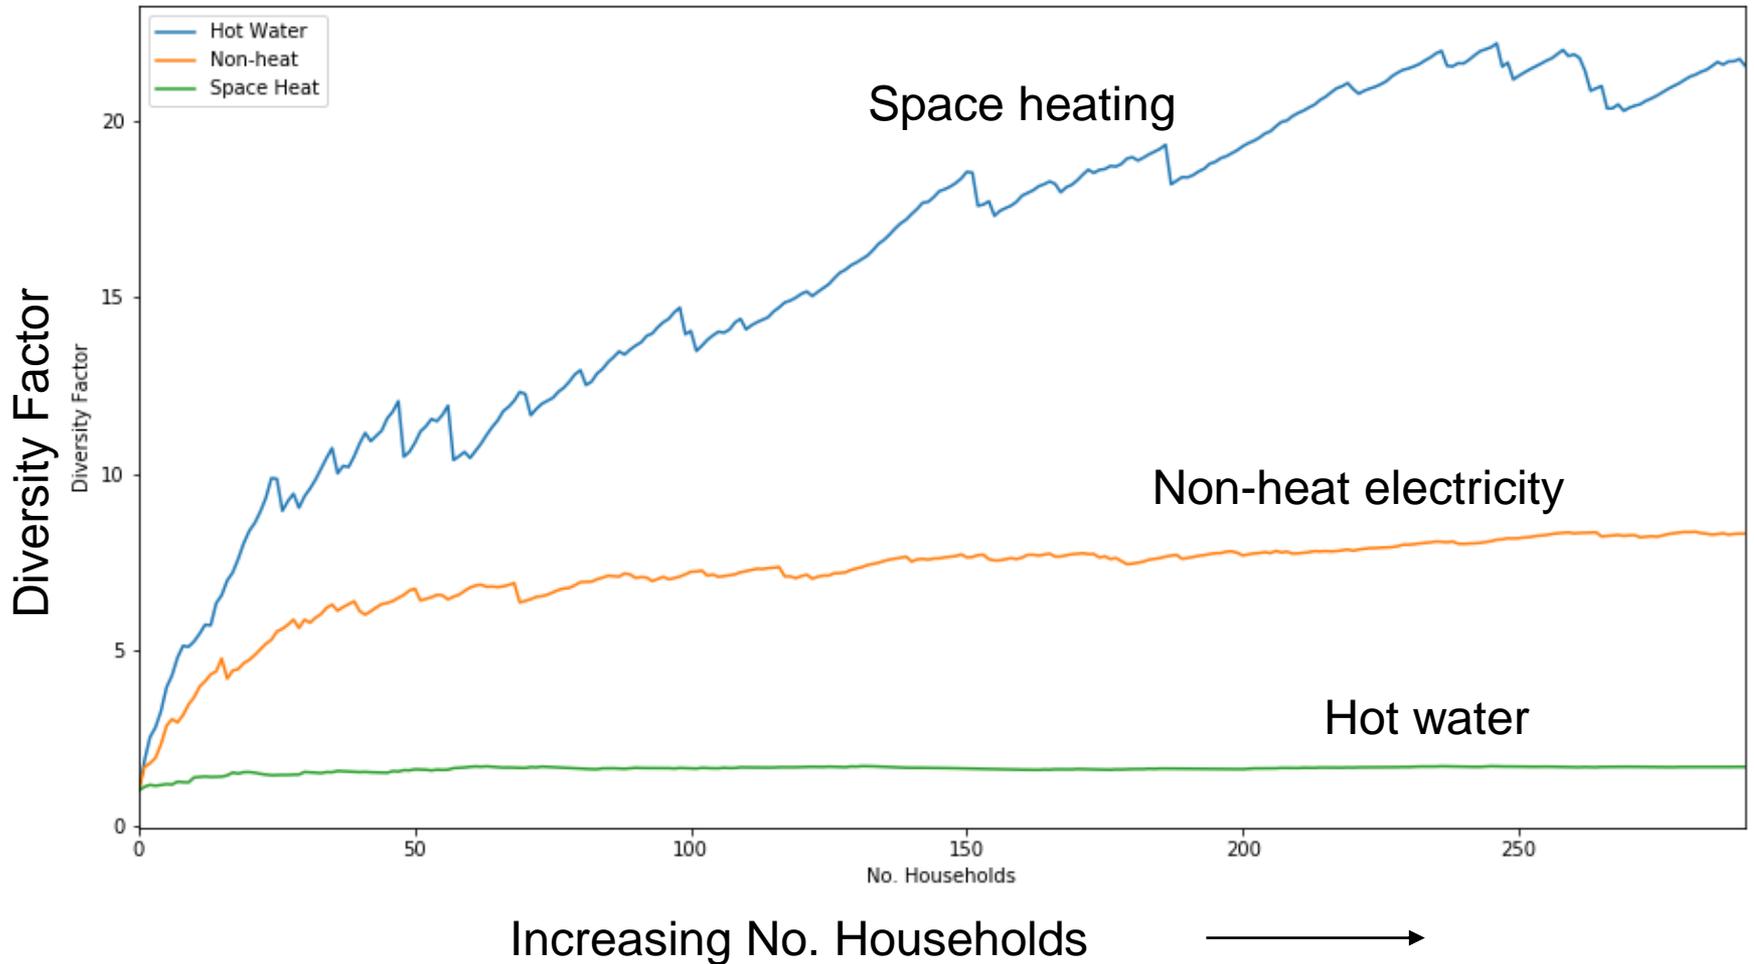


Problem 3: Where has all the hot water storage gone?

- UK domestic new-build properties are shrinking
- Combi boiler installations have 'freed up' additional space in many houses which is now being used as living space
- Many new-builds may not have sufficient supportive infrastructure (or space) to retrofit
- BEIS 'Future Framework For Heat in Buildings' call for evidence is considering futureproofing for storage in new build requirements




Problem 4: Working with the system we have


1 house
3 occupants

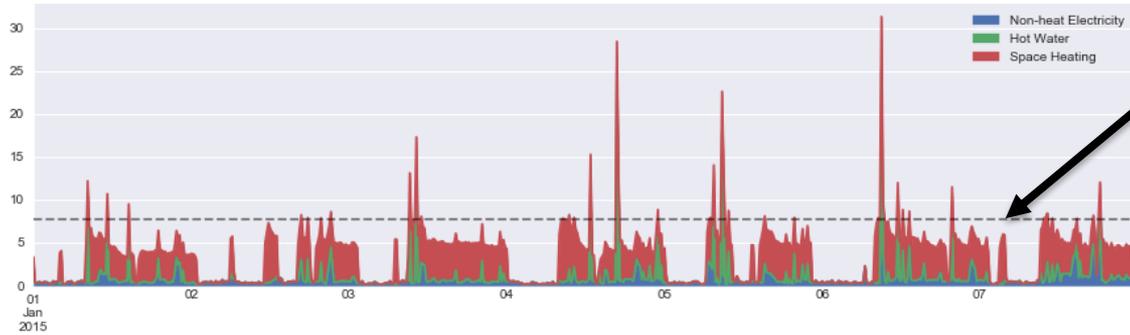


1 LV Feeder
59 houses
162 occupants

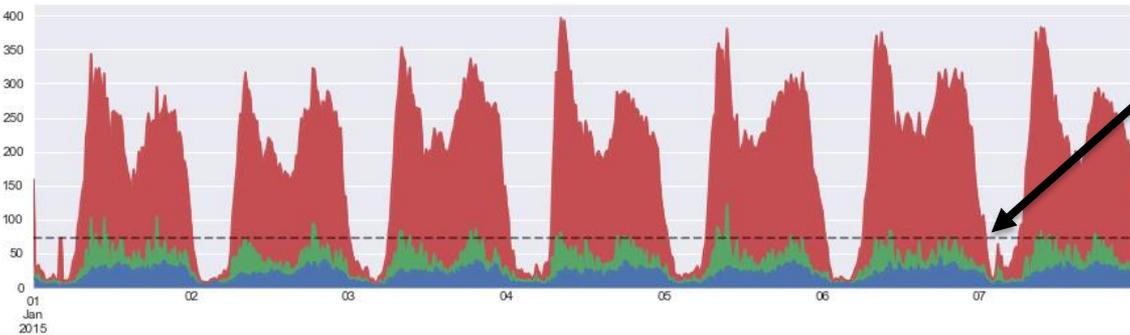

1 LV Xformer
292 houses
697 occupants

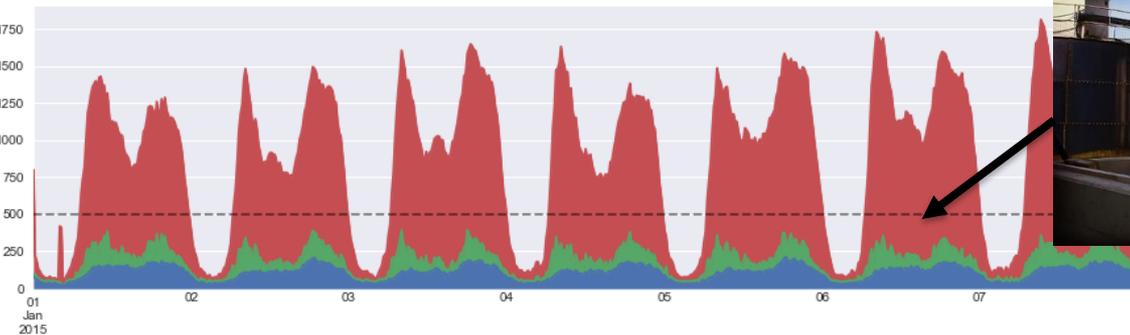


Problem 5: Coordination is complex

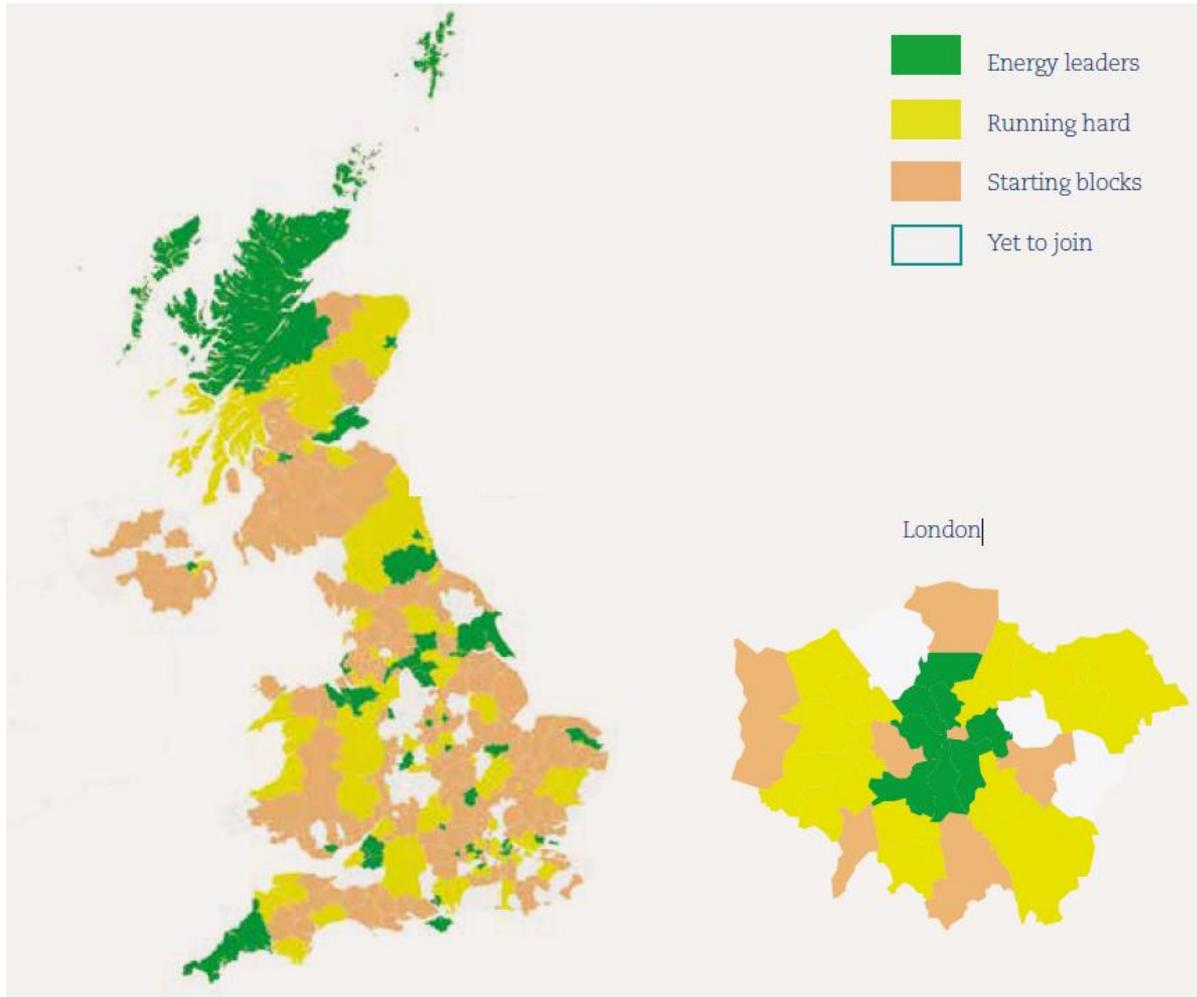

Solution 1: Recognising spatial heterogeneity


Before spatial disaggregation

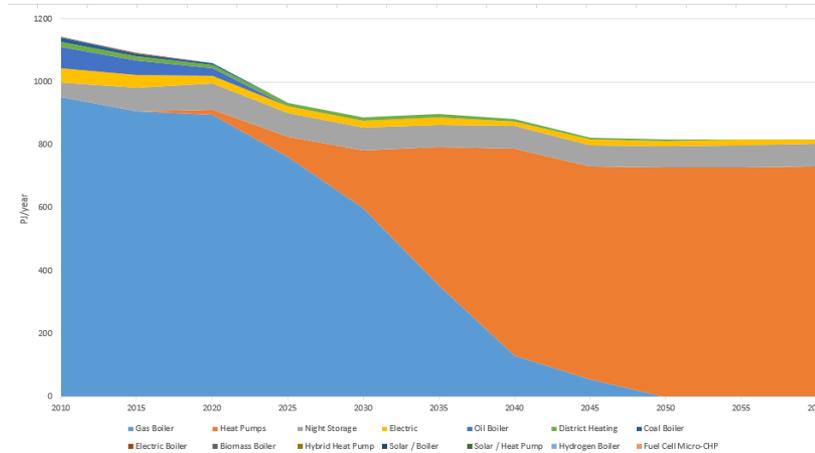

Heat pumps are the solution to all of our problems!

The Whole System View

After spatial disaggregation



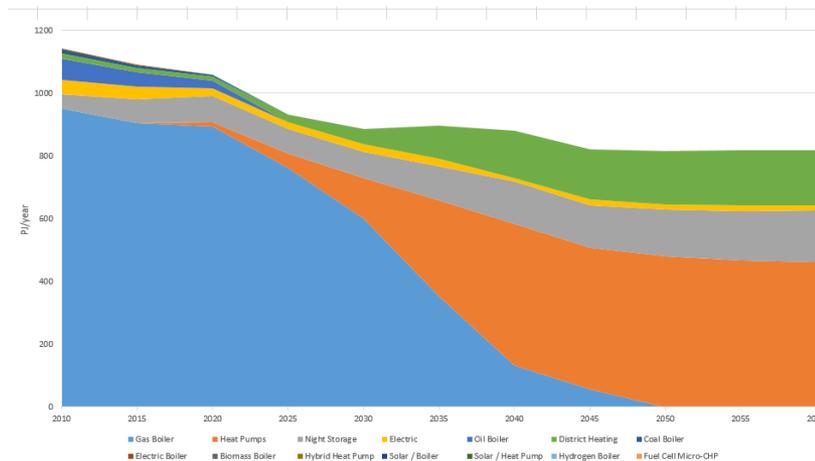


Economic heat network opportunities in densely populated urban areas

Increased value of heat storage in rural areas

Heat pumps remain as key technology displacing natural gas boilers over time

Solution 2: Opportunities from curtailed renewables

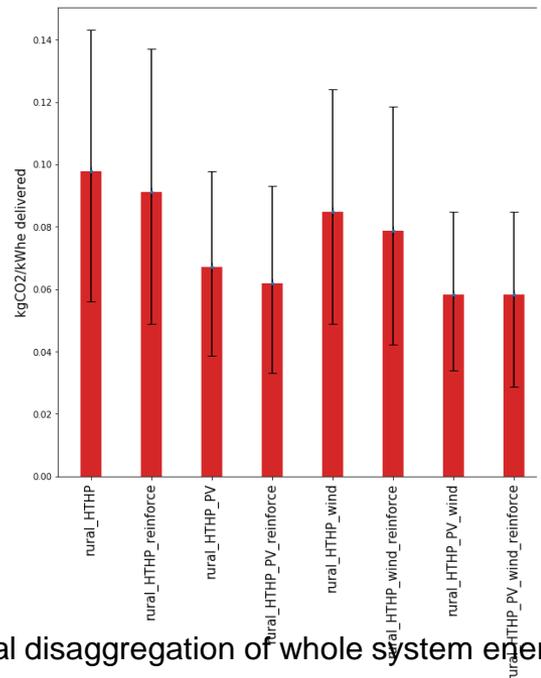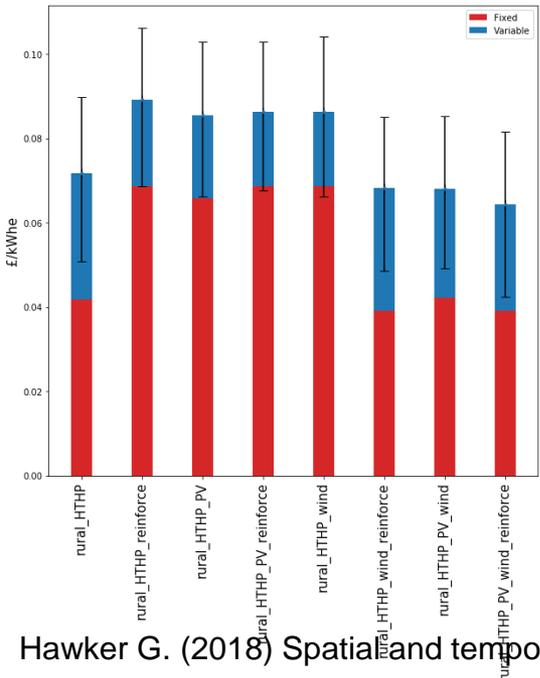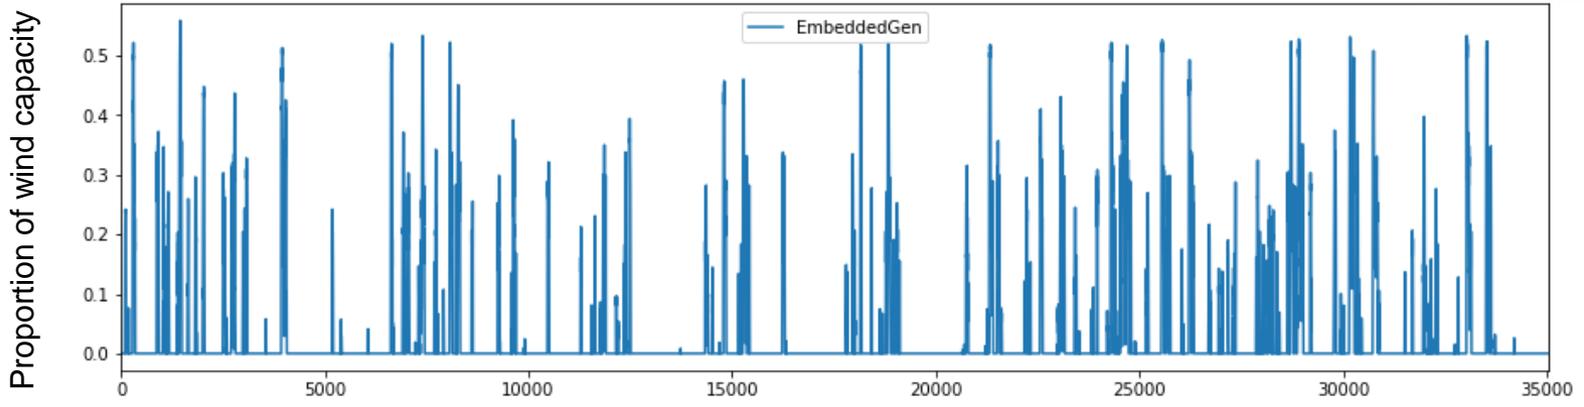


| End Use Technology | Scenario | | | Average Abatement Cost compared to Base Scenario (£/kgCO ₂) |
|----------------------------|----------|------|---------------|---|
| | PV | Wind | Reinforcement | |
| High Temperature Heat Pump | - | Yes | Yes | -0.203 |
| High Temperature Heat Pump | - | - | Yes | -0.195 |
| High Temperature Heat Pump | - | Yes | - | -0.190 |
| High Temperature Heat Pump | - | - | - | -0.183 |
| High Temperature Heat Pump | Yes | - | Yes | -0.091 |
| High Temperature Heat Pump | Yes | Yes | - | -0.086 |
| High Temperature Heat Pump | Yes | Yes | Yes | -0.086 |
| High Temperature Heat Pump | Yes | - | - | -0.077 |
| Ground-to-water Heat Pump | - | - | - | -0.052 |
| Air-air Heat Pump | - | - | - | 0.054 |

Abatement costs for high temperature heat pump scenarios compared to fuel oil condensing boilers, rural model, central assumptions

Solution 3: Heat buffering and thermal storage


Net space heat demand: building efficiency reduces total energy and provides temporal buffering

Heat pumps utilise decarbonised electricity (local and grid) to limit of network capacity (minus other electrical demand)



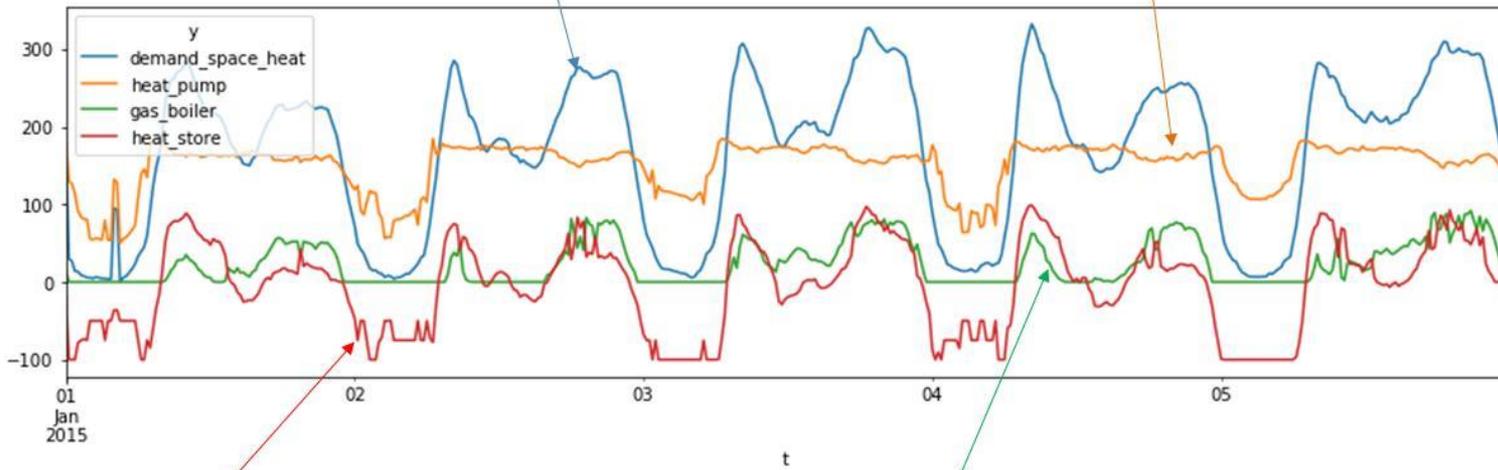


Heat storage increases utilization of heat pump capacity

Existing gas network and boilers provide remainder of space heating

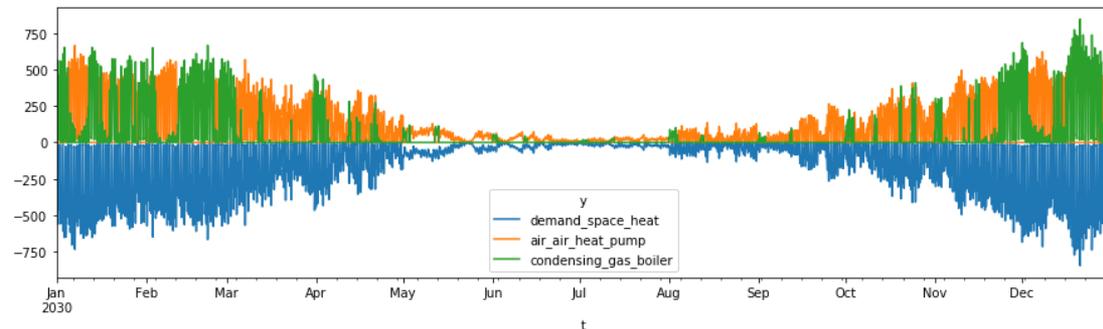

Solution 4: Targeting the right technologies at the right people

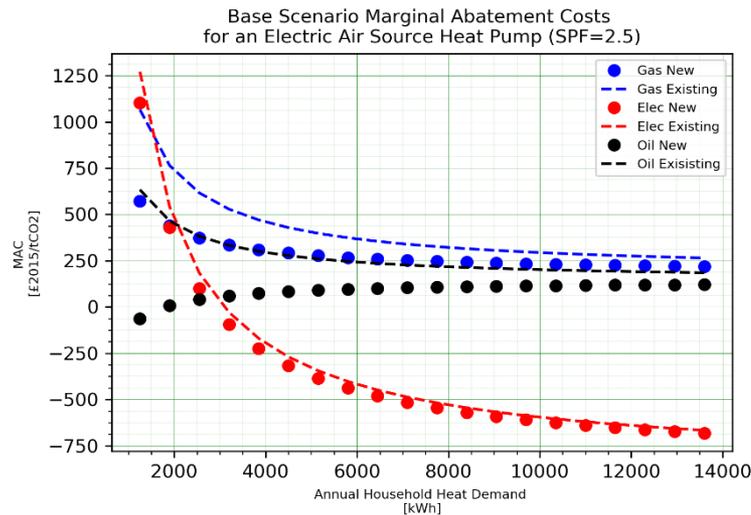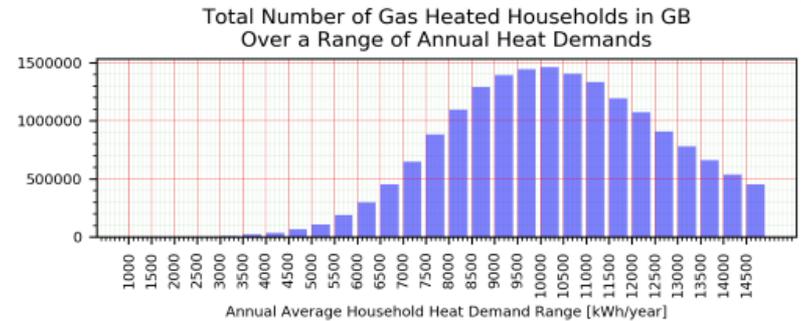
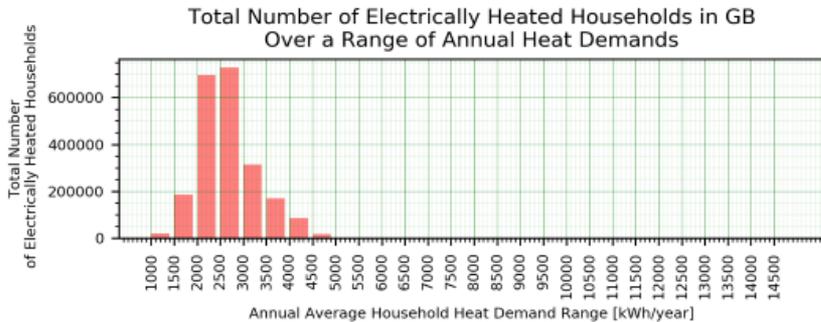


Sources: [1] England, Northern Ireland, Scotland and Wales 2011 Census: Office for National Statistics ; National Records of Scotland ; Northern Ireland Statistics and Research Agency (2017): 2011 Census aggregate data. UK Data Service (Edition: February 2017). DOI: <http://dx.doi.org/10.5257/census/aggregate-2011-2>; [2] UK GOV, Sub-national electricity and gas consumption data 2015

University of Strathclyde IPPI blog October 2018 - Reducing emissions from heating our homes – does one size fit all?

<https://www.strath.ac.uk/research/internationalpublicpolicyinstitute/ourblog/october2018/reducingemissionsfromheatingourhomesdoesonesizefitall/>



Solution 5: Recognising the link between buildings and networks

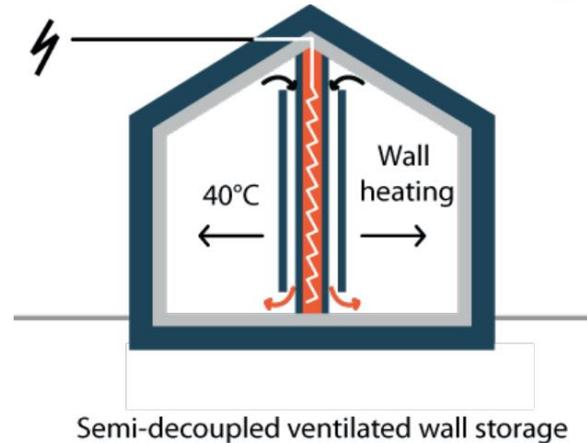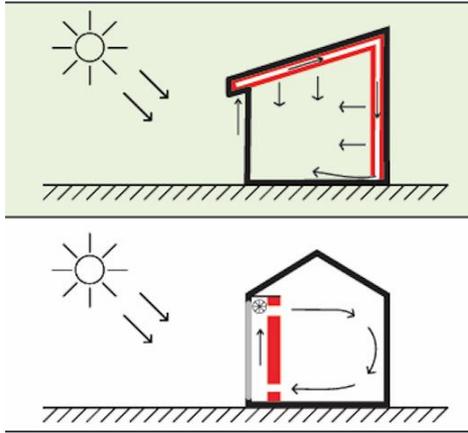

Solid Storage heated and cooled with heat pump

Solid storage with water as the heat distribution fluid

Other locations:
Exterior walls and under staircases

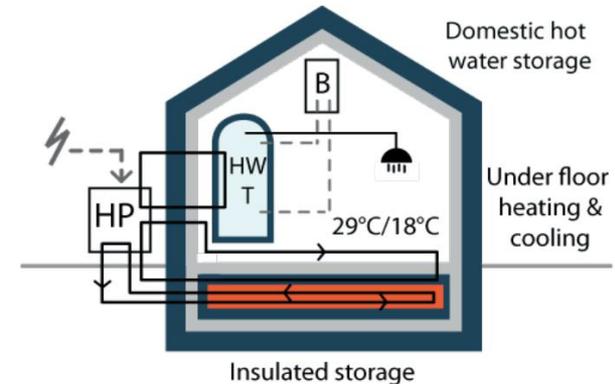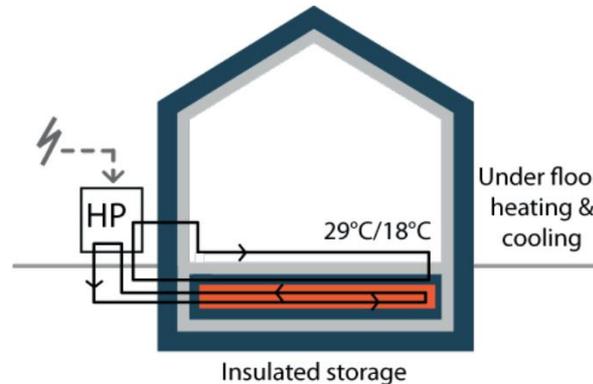

So what?

- Building standards and efficiency have direct and significant impacts on network requirements, not only in terms of aggregate demand
- An individualist approach to heat provision creates significant overcapacity
- Heat solutions which do not entirely displace incumbent technologies may imply overcapacity of both end-use technologies and network
- The UK is a highly spatially heterogeneous system with a broad variety of extant technologies and use cases, and great care should be taken in extrapolating from case studies
- The least-cost and least-emissions pathways (both for the system and consumer) are subject to high uncertainty due to the wide range of future technology cost estimates and fuel carbon intensities